



above-desk | below-desk | beyond-desk

nexus

Panel mount power module OSL102 instructions

Safety warning

For your safety, this product must be installed in accordance with local Building Regulations. **If in any doubt, or where required by the law, consult a competent person who is registered with an electrical self-certification scheme. Wiring should be in accordance with the latest edition of the IET regulations (BS 7671) . If the unit is being installed in an office environment by means of a 13A plug please ensure BS6396 is adhered to.**

Please read carefully and use in accordance with these safety wiring instructions.

Before commencing any electrical work ensure the supply is switched off at the mains. To prevent fire hazard always use cable of the correct rating & type for the application.

Warning do not exceed the load rating of this device as stated on the rear of the product.

Built in protection

This product has been designed to protect connected equipment as well as end user. Each socket outlet has protection in the form of a 3A resettable thermal fuse that detects overloads or any defective equipment that may be connected.

continued...

Connecting to a panel or desk

Rout or cut a hole measuring 106 (w) x 58 (h) mm (5mm corner radii) in to your panel/desk.


Push the OSL102 through the hole from the front and hold in position. Push the retaining collar on to the rear of the product until it fits securely in place.



Connecting to the power supply

Push the GST connector from the OSL102 in to a NEX1003xx Starter Lead (fig. 1) or NEX3001 Power Module (fig. 2) until the clip engages and you hear a “click”.

fig. 1

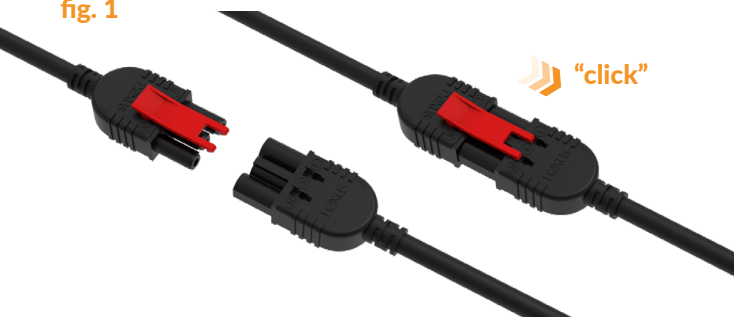

continued...

fig. 2



Resetting the built in protective device

If there is no power due to an overloaded socket or defective equipment being connected, the built in protection switch will operate. A red indicator will be raised and the protection switch will need resetting.

Please follow the below steps to reset the device:


- 1 Remove plug.



continued...


2

Confirm the red indicator beneath the plug is visible.

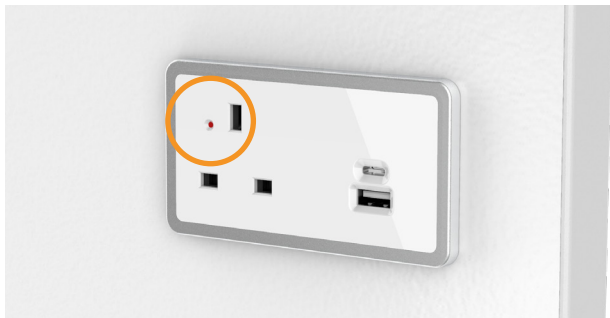


3

Locate reset tool and insert in to the reset opening.

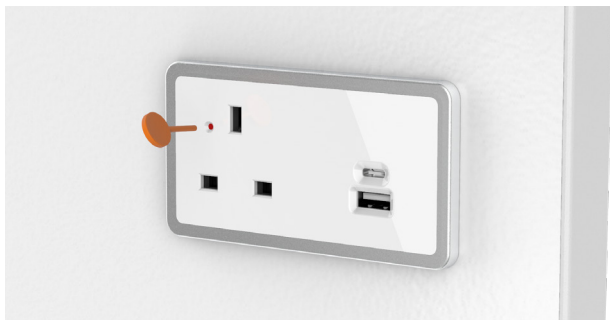

4


Push until it clicks.

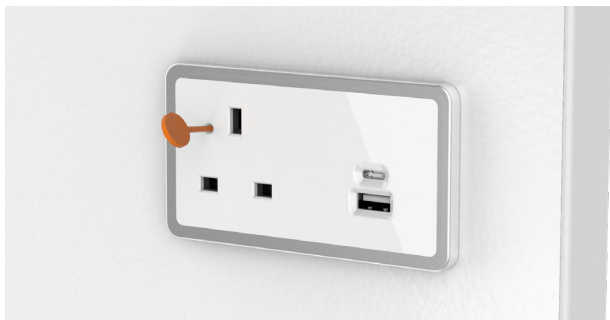

continued...

5

Remove tool.

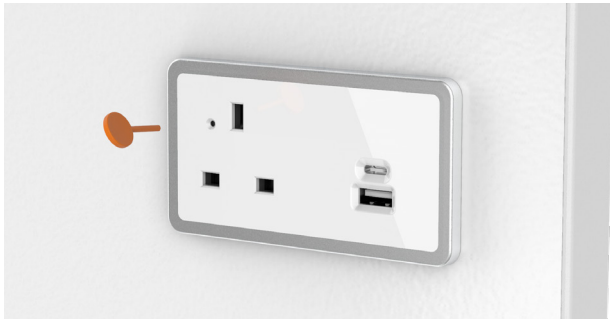

6

Once the fault has been investigated and rectified reconnect the equipment.



USB operating guidelines

USB smart charging technology detects the connected devices and adjusts the charging pattern and output to suit. When the device is fully charged the USB outlets revert to low energy standby mode.

The smart technology constantly monitors the charge output and will shut down in the event of any overload condition, thus protecting the connected devices.

Total charger current can be delivered from one USB socket or divided between outputs as required.

continued...

The speed of charging will depend on the battery capacity of the device and not charge output of the socket.

The total output current achieved is dictated by the specific device being charged and other external factors, such as the quality of charging cable being used.

For more information and trouble shooting visit our website FAQs.

The USB circuits in this socket are designed to withstand insulation resistance tests at 500V. A reading of 10M minimum is typically achieved by the USB socket.

USB Output	Average active efficiency	Efficiency at low load (10%)
Type C:		
5.0V DC, 3.0A 15.0W MAX	>81.39%	>72.48%
9.0V DC, 3.0A 27.0W MAX	>86.62%	>77.30%
12.0V DC, 2.5A 30.0W MAX	>86.95%	>77.70%
15.0V DC, 2.0A 30.0W MAX	>86.95%	>77.70%
20.0V DC, 1.5A 30.0W MAX	>86.95%	>77.70%
Type A:		
5.0V DC 3.0A 15.0W MAX	>81.39%	>72.48%
9.0V DC 3.0A 27.0W MAX	>86.62%	>77.30%
12.0V DC 2.25A 27.0W MAX	>86.62%	>77.30%
No load power consumption	USB Port Number	
<0.10W	2 Ports (1 type A, 1 type C)	

continued...

Technical

Voltage: 220-250V ac

Frequency: 50/60Hz

Rating:

1 socket: 3A 720W

2 socket: 6A 1440W

3A individual resets (2 resets for OSL102x2x models)

Construction:

Polycarbonate, VO rated ABS/PC blend current carrying plastic.

Aluminium casing.

Standards:

Tested to BS5733, BS1363-2

Connectors:


1 socket (OSL102x1x, OSL102x3x),

2 sockets (OSL102x2x),

3 pole GST18 input

Mounting options:

Standalone using included bracket. 1-20mm panel thickness.

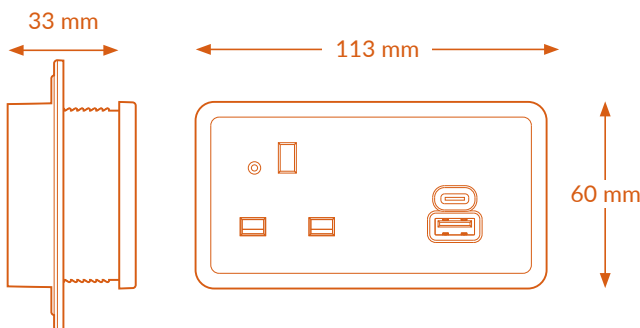

ASTA Approved

The ASTA quality mark is evidence that the product has been independently tested to comply with the relevant clauses of the applicable standards.



Intertek
Lic No. 1418

continued...

Service conditions

This module is only suitable for use under the following conditions of service:

- 1 An ambient temperature range of -5°C to $+40^{\circ}\text{C}$, with an average value not exceeding $+35^{\circ}\text{C}$ over one full day.
- 2 An altitude not exceeding 2000m above sea level.
- 3 An atmosphere not subject to excessive pollution by smoke, chemical or flammable fumes; salt-laden spray; prolonged periods of high humidity or other abnormal conditions.
- 4 Not suitable for exposure to direct radiation from the sun or other source of heat likely to raise the temperature above the designated ambient, nor may it be suitable for subjection to excessive vibration.

Where service conditions differ from those prescribed above the advice of the manufacturer or responsible vendor should be sought.

Batch code explanation

yyWxx Manufacturing date code, year of manufacture (yy) and week of manufacture (Wxx)

continued...

Address / Helpline

If you need further technical assistance you can get in touch with our **Technical Helpline** on
+44 (0)3300 249 279
email: support@nexus.uk

Luceco PLC
Stafford Park 1
Telford TF3 3BD
ENGLAND

(EU) Luceco SE
C/ Bobinadora 1-5
08302 Mataró
SPAIN

Environmental protection



This symbol is known as the “Crossed-out Wheelie Bin”. This product should not be disposed of with general household waste.

Some chemicals contained within electrical/electronic products can be harmful to health and environment. Only dispose of electrical/electronic items in separate collection schemes, which cater for the recovery and recycling of materials contained within. Your co-operation is vital to ensure the success of these schemes and for the protection of the environment.

nexus

www.nexus.uk | contact@nexus.uk | 01952 238100



Nexus_UK



@TweetNexusUK



NexusUK



NexusUK